
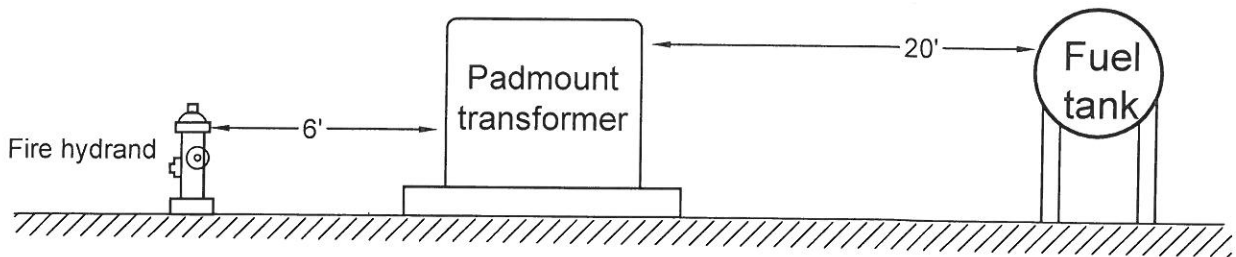
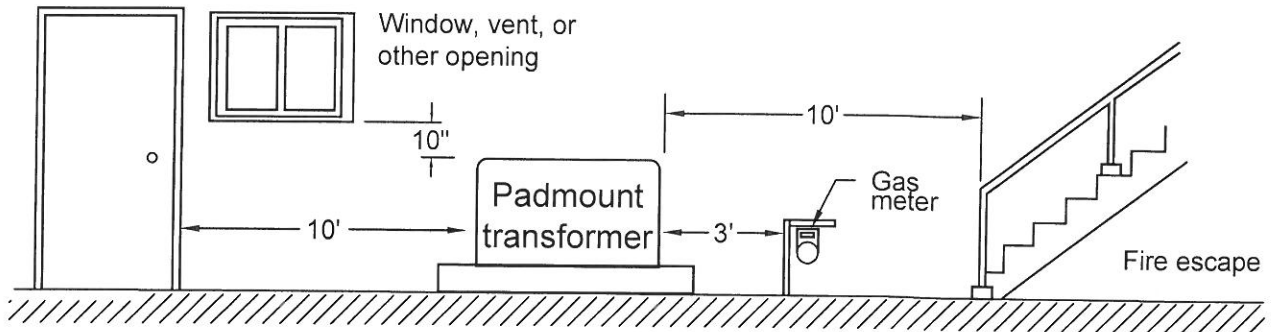
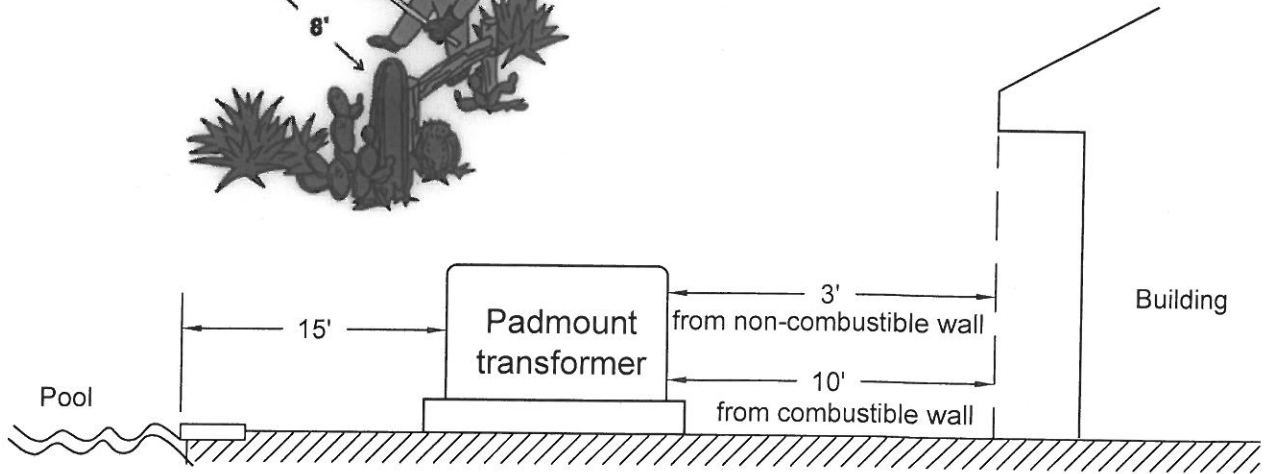


Note:

- Keep shrubs, landscape material and structures 8 feet away from the doors and 18 inches away from the sides of transformer

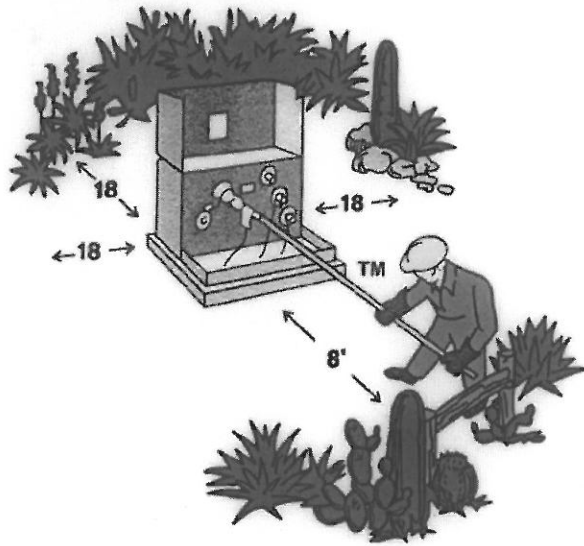

Source: Safety Clearances Around Padmount Transformers, p. 58-59, Distribution Transformer Handbook, 1st Ed., October 2001

ELECTRIC STANDARD

DRAWN: HV

DATE: 2-5-13

SCALE: NTS

CLEARANCE REQUIREMENTS AROUND PAD MOUNT TRANSFORMER

APPROVED:

Juen K. Chong 2-26-13

DATE

DWG. NO.

ED26

SHEET

1 OF 1

